


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
2. Municipal jurisdiction will require city inspection of loop before connection.
3. Notify Bartlett Electric Cooperative when breaker is installed.
4. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.

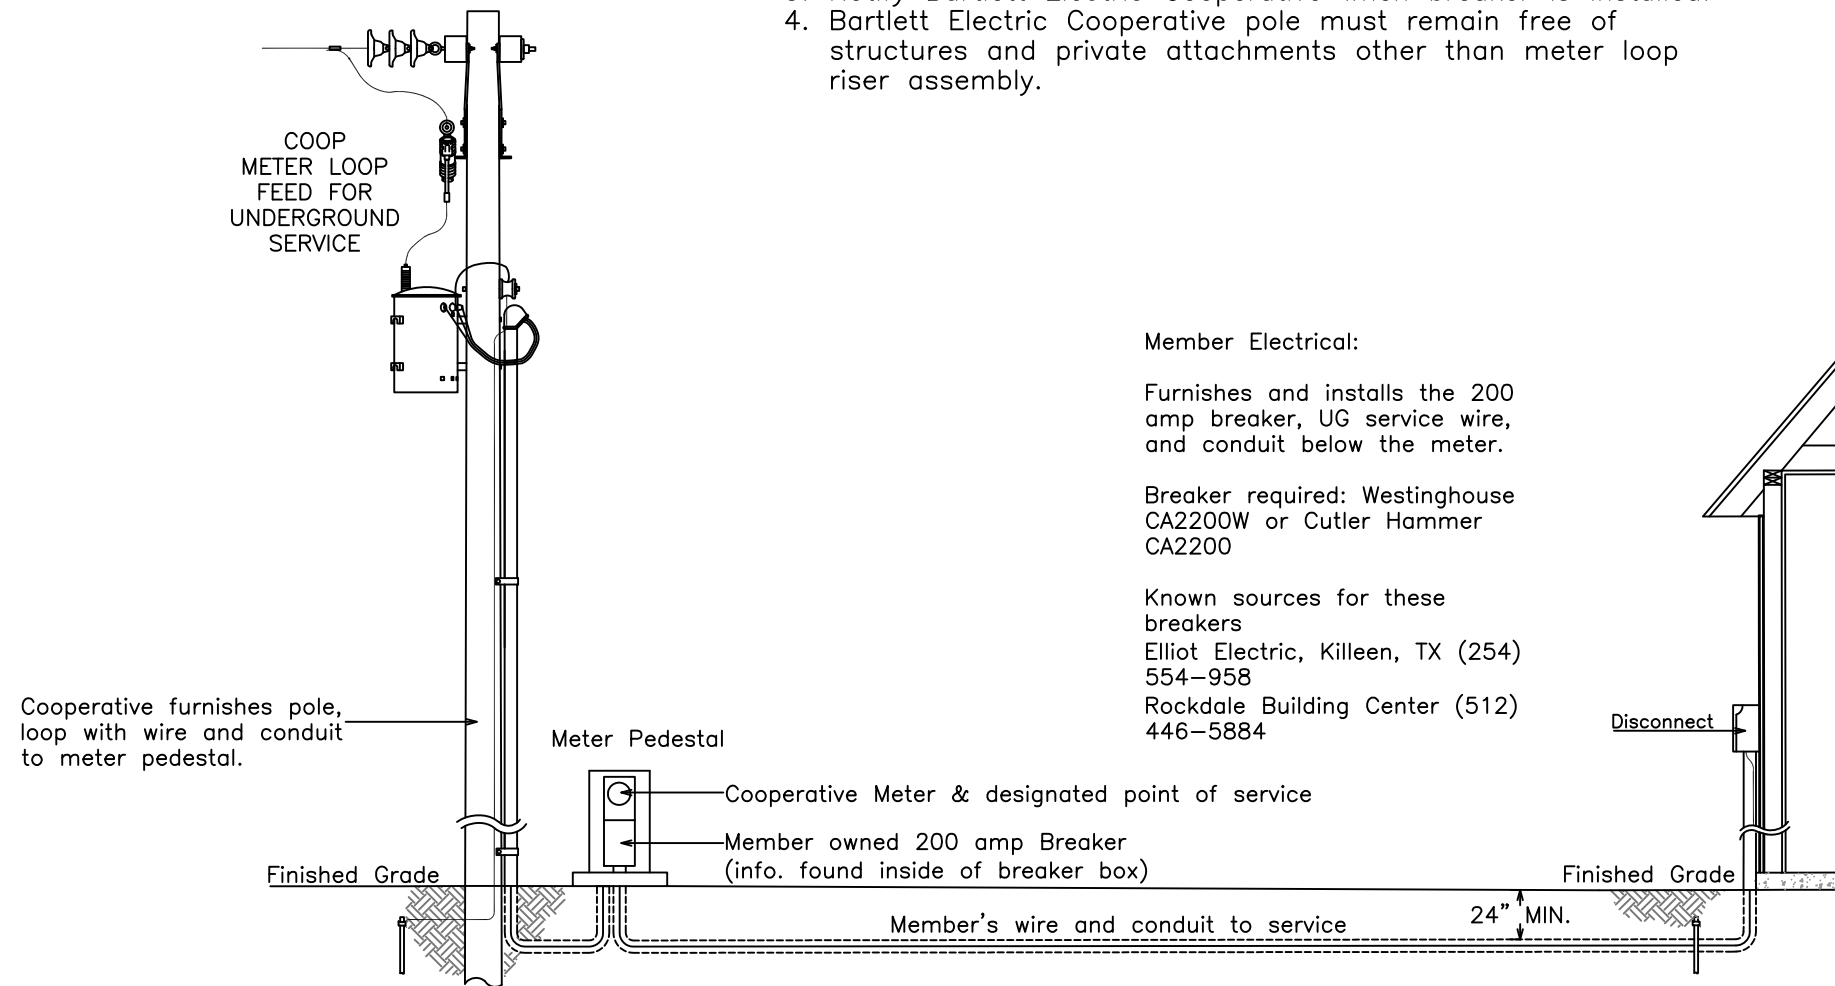

Member Electrical:

Furnishes and installs the 200 amp breaker, UG service wire, and conduit below the meter.

Breaker required: Westinghouse CA2200W or Cutler Hammer CA2200

Known sources for these breakers
 Elliot Electric, Killeen, TX (254) 554-958
 Rockdale Building Center (512) 446-5884

FOR THE MEMBER'S SAFETY,
 WIRING INSTALLATIONS SHALL
 CONFORM TO THE REQUIREMENTS
 OF THE NEC AND NESC.



BEC Power
 27492 HWY 95
 Bartlett, Texas 76511

SINGLE PHASE, 200AMP
 UNDERGROUND SERVICE
 CLASS 200AMP METER AND PEDESTAL

Drawn By: SEP	Checked By: GP	Approved By: KGS	Revised by: SE
Scale: N.T.S.	Date: 07-26-21	Drawing #: BEC-MS-6	Date: 07/26/2021