


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
2. Municipal jurisdiction will require city inspection of loop before connection.
3. Notify Bartlett Electric Cooperative when breaker is installed.
4. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.

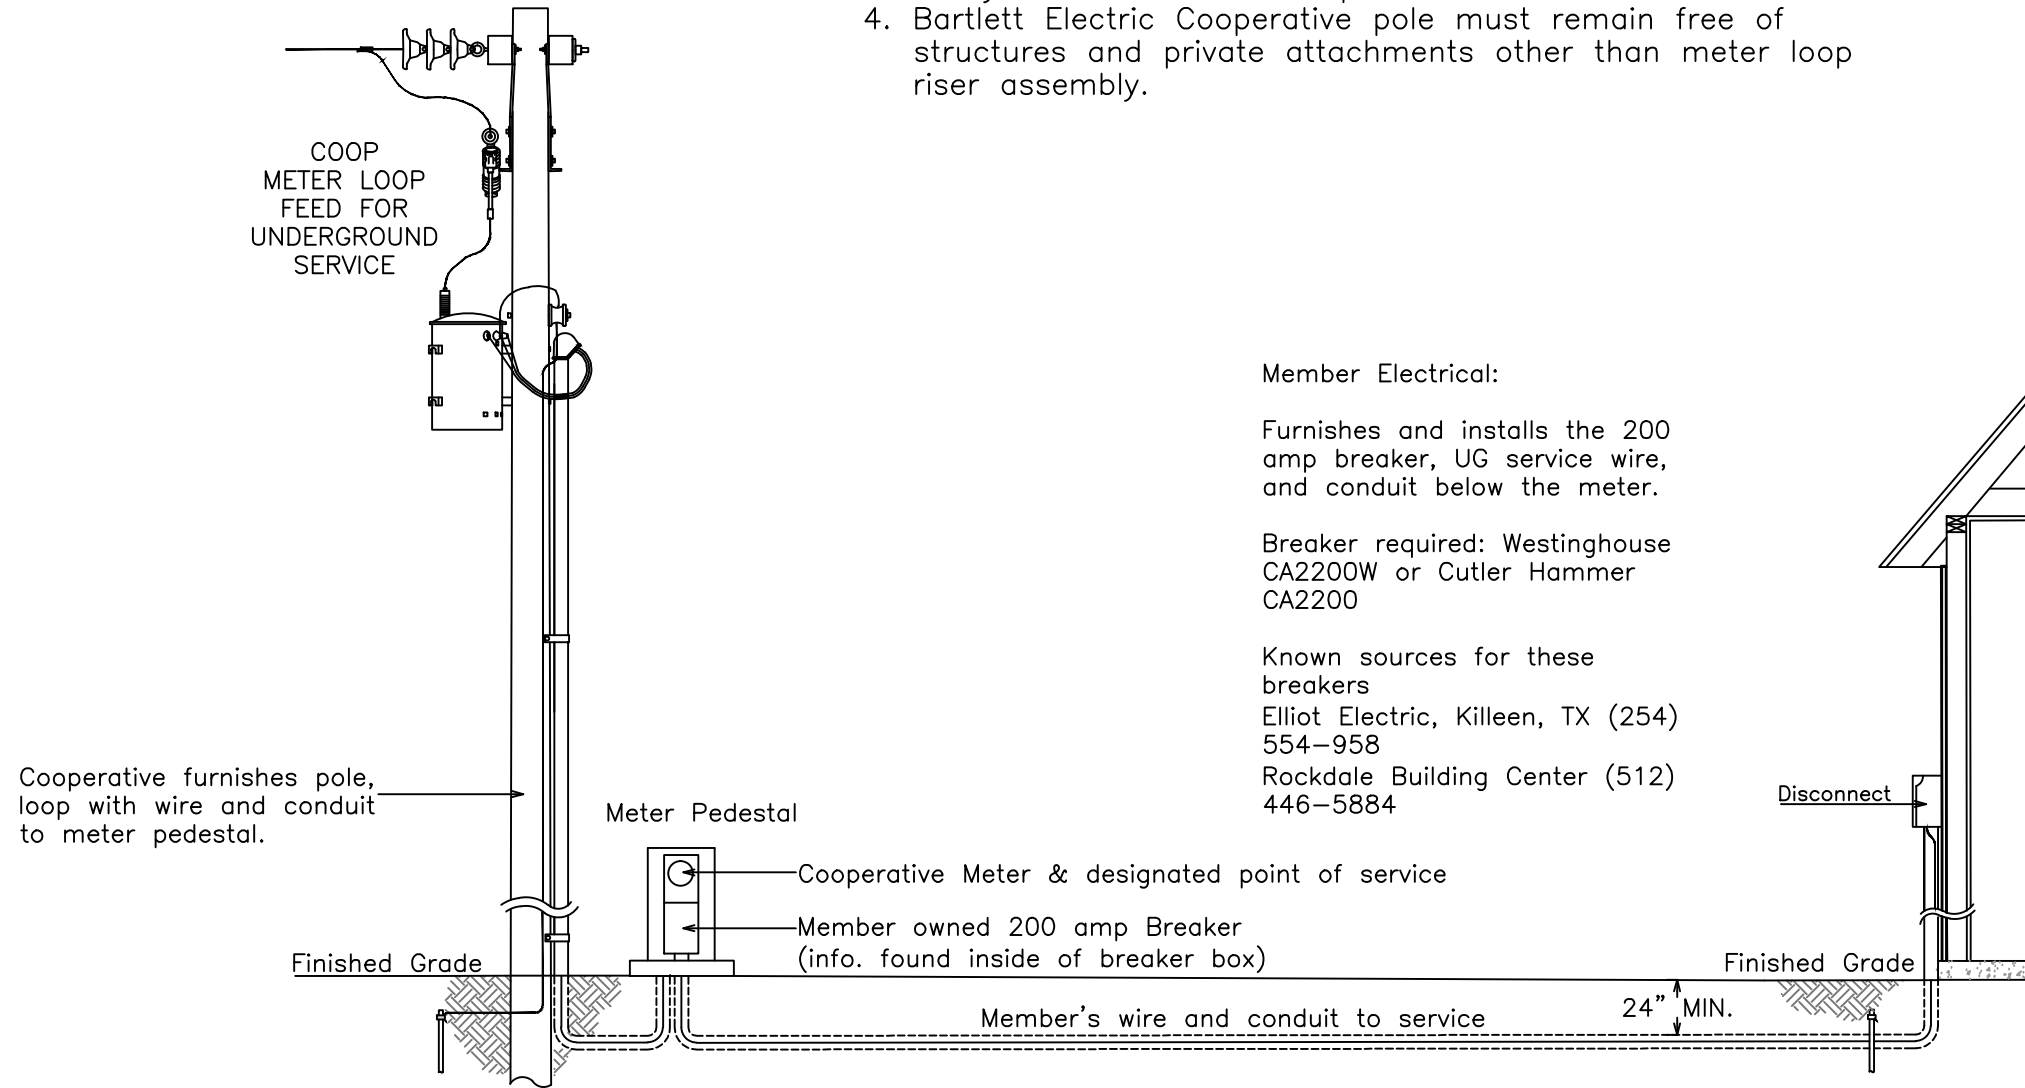

Member Electrical:

Furnishes and installs the 200 amp breaker, UG service wire, and conduit below the meter.

Breaker required: Westinghouse CA2200W or Cutler Hammer CA2200

Known sources for these breakers
 Elliot Electric, Killeen, TX (254) 554-958
 Rockdale Building Center (512) 446-5884

Cooperative furnishes pole, loop with wire and conduit to meter pedestal.

FOR THE MEMBER'S SAFETY,
 WIRING INSTALLATIONS SHALL
 CONFORM TO THE REQUIREMENTS
 OF THE NEC AND NESC.

Bartlett Electric Cooperative, Inc. P.O. Box 200 Bartlett, Texas 76511	SINGLE PHASE, 200AMP UNDERGROUND SERVICE CLASS 200AMP METER AND PEDESTAL	Drawn By: TE, MEI	Checked By: -	Approved By: -	Revised by: AH
		Scale: N.T.S.	Date: 09/08/2014	Drawing #: BEC-MS-6	Date: 09-08-14