


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
2. Municipal jurisdiction will require city inspection of loop before connection.
3. Addition of future load should be considered when sizing meter loop.
4. Minimum wire size for: 100amp meter loop, #2 copper; 200amp meter loop, 2/0 copper; other—contact office.
5. Mark neutral with white tape or stripped insulation
6. Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.
7. Meter loops not allowed on mobile homes.

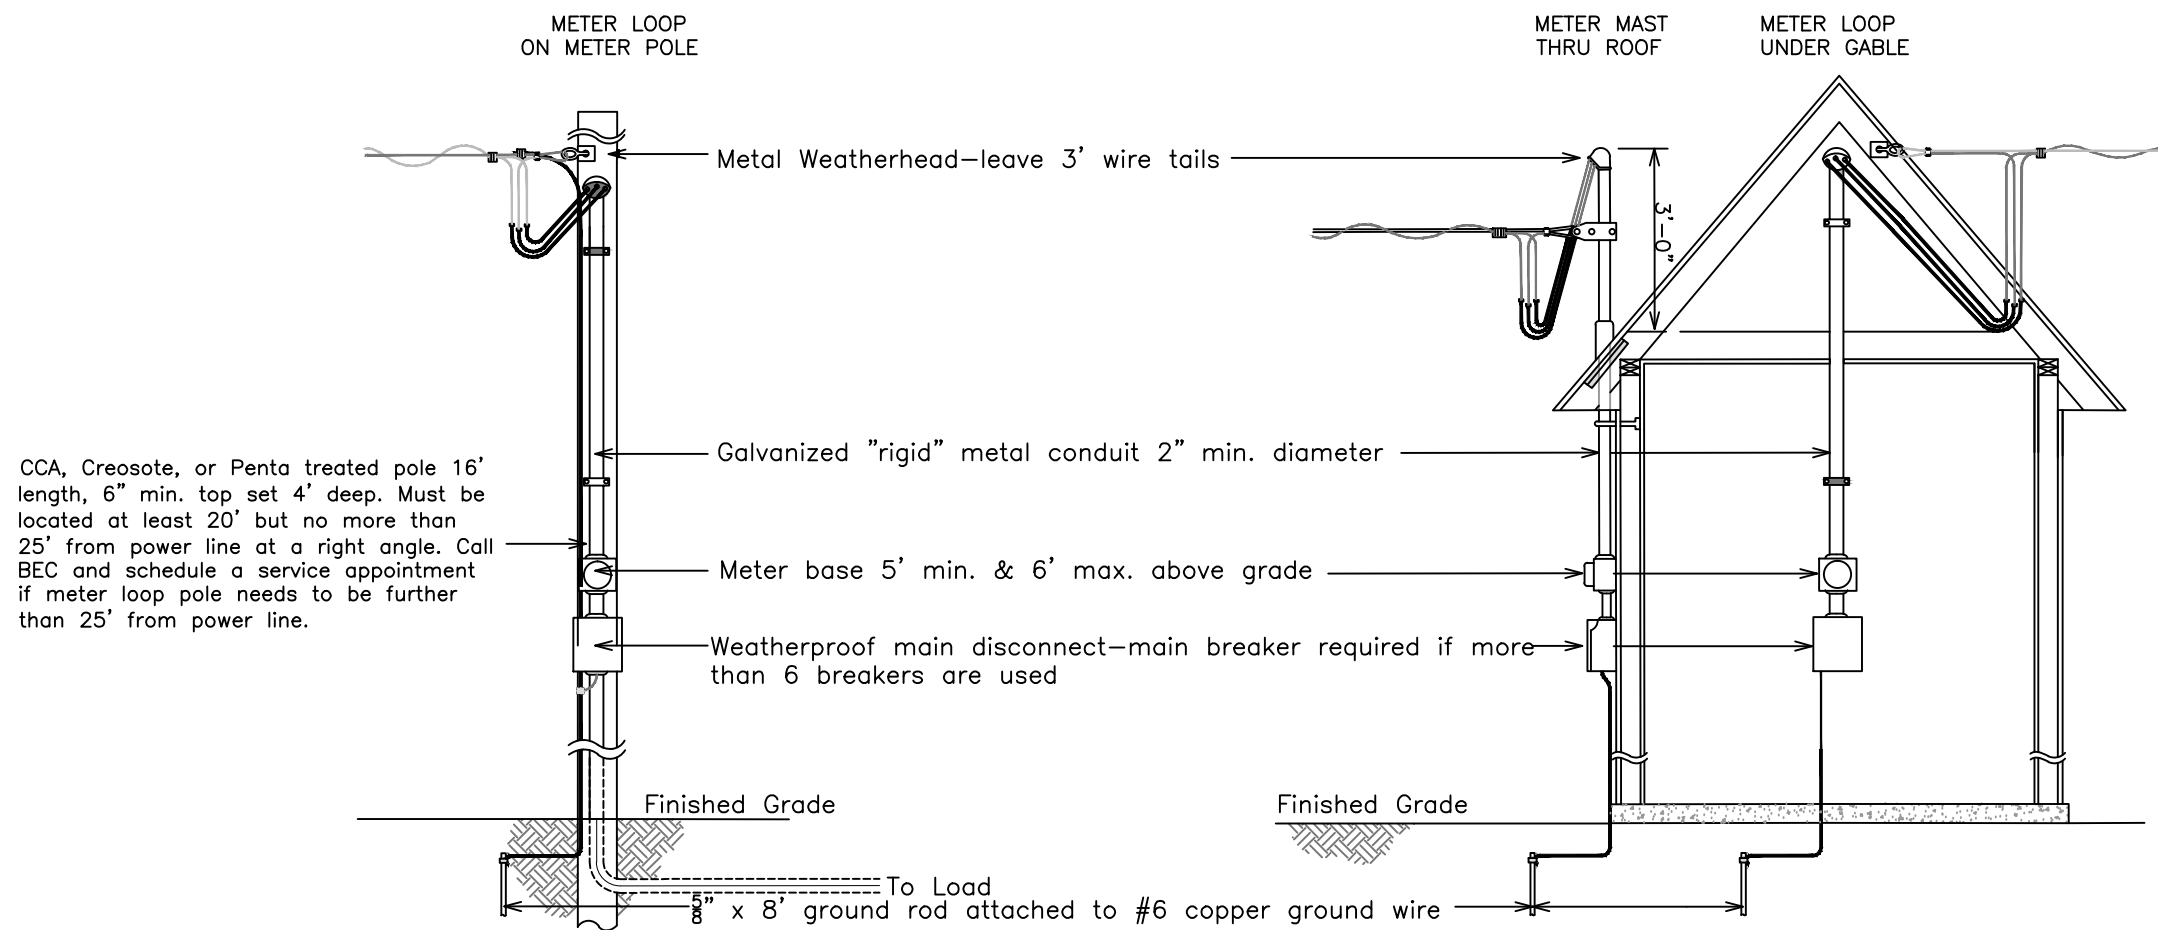

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

Bartlett Electric Cooperative, Inc. P.O. Box 200 Bartlett, Texas 76511	SINGLE PHASE, 200AMP SERVICE OVERHEAD METER LOOP WITH CLASS 200AMP METER SOCKET	Drawn By: TE, MEI	Checked By: —	Approved By: —	Revised by: AH
		Scale: N.T.S.	Date: 08/26/2014	Drawing #: BEC-MS-7	Date: 09-08-14