


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
2. Addition of future load should be considered when sizing meter loop.
3. Minimum wire size for: 2/0 copper. 4/0 AL.
4. Mark neutral with white tape or stripped insulation
5. Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.
6. Meter loops not allowed on mobile homes.

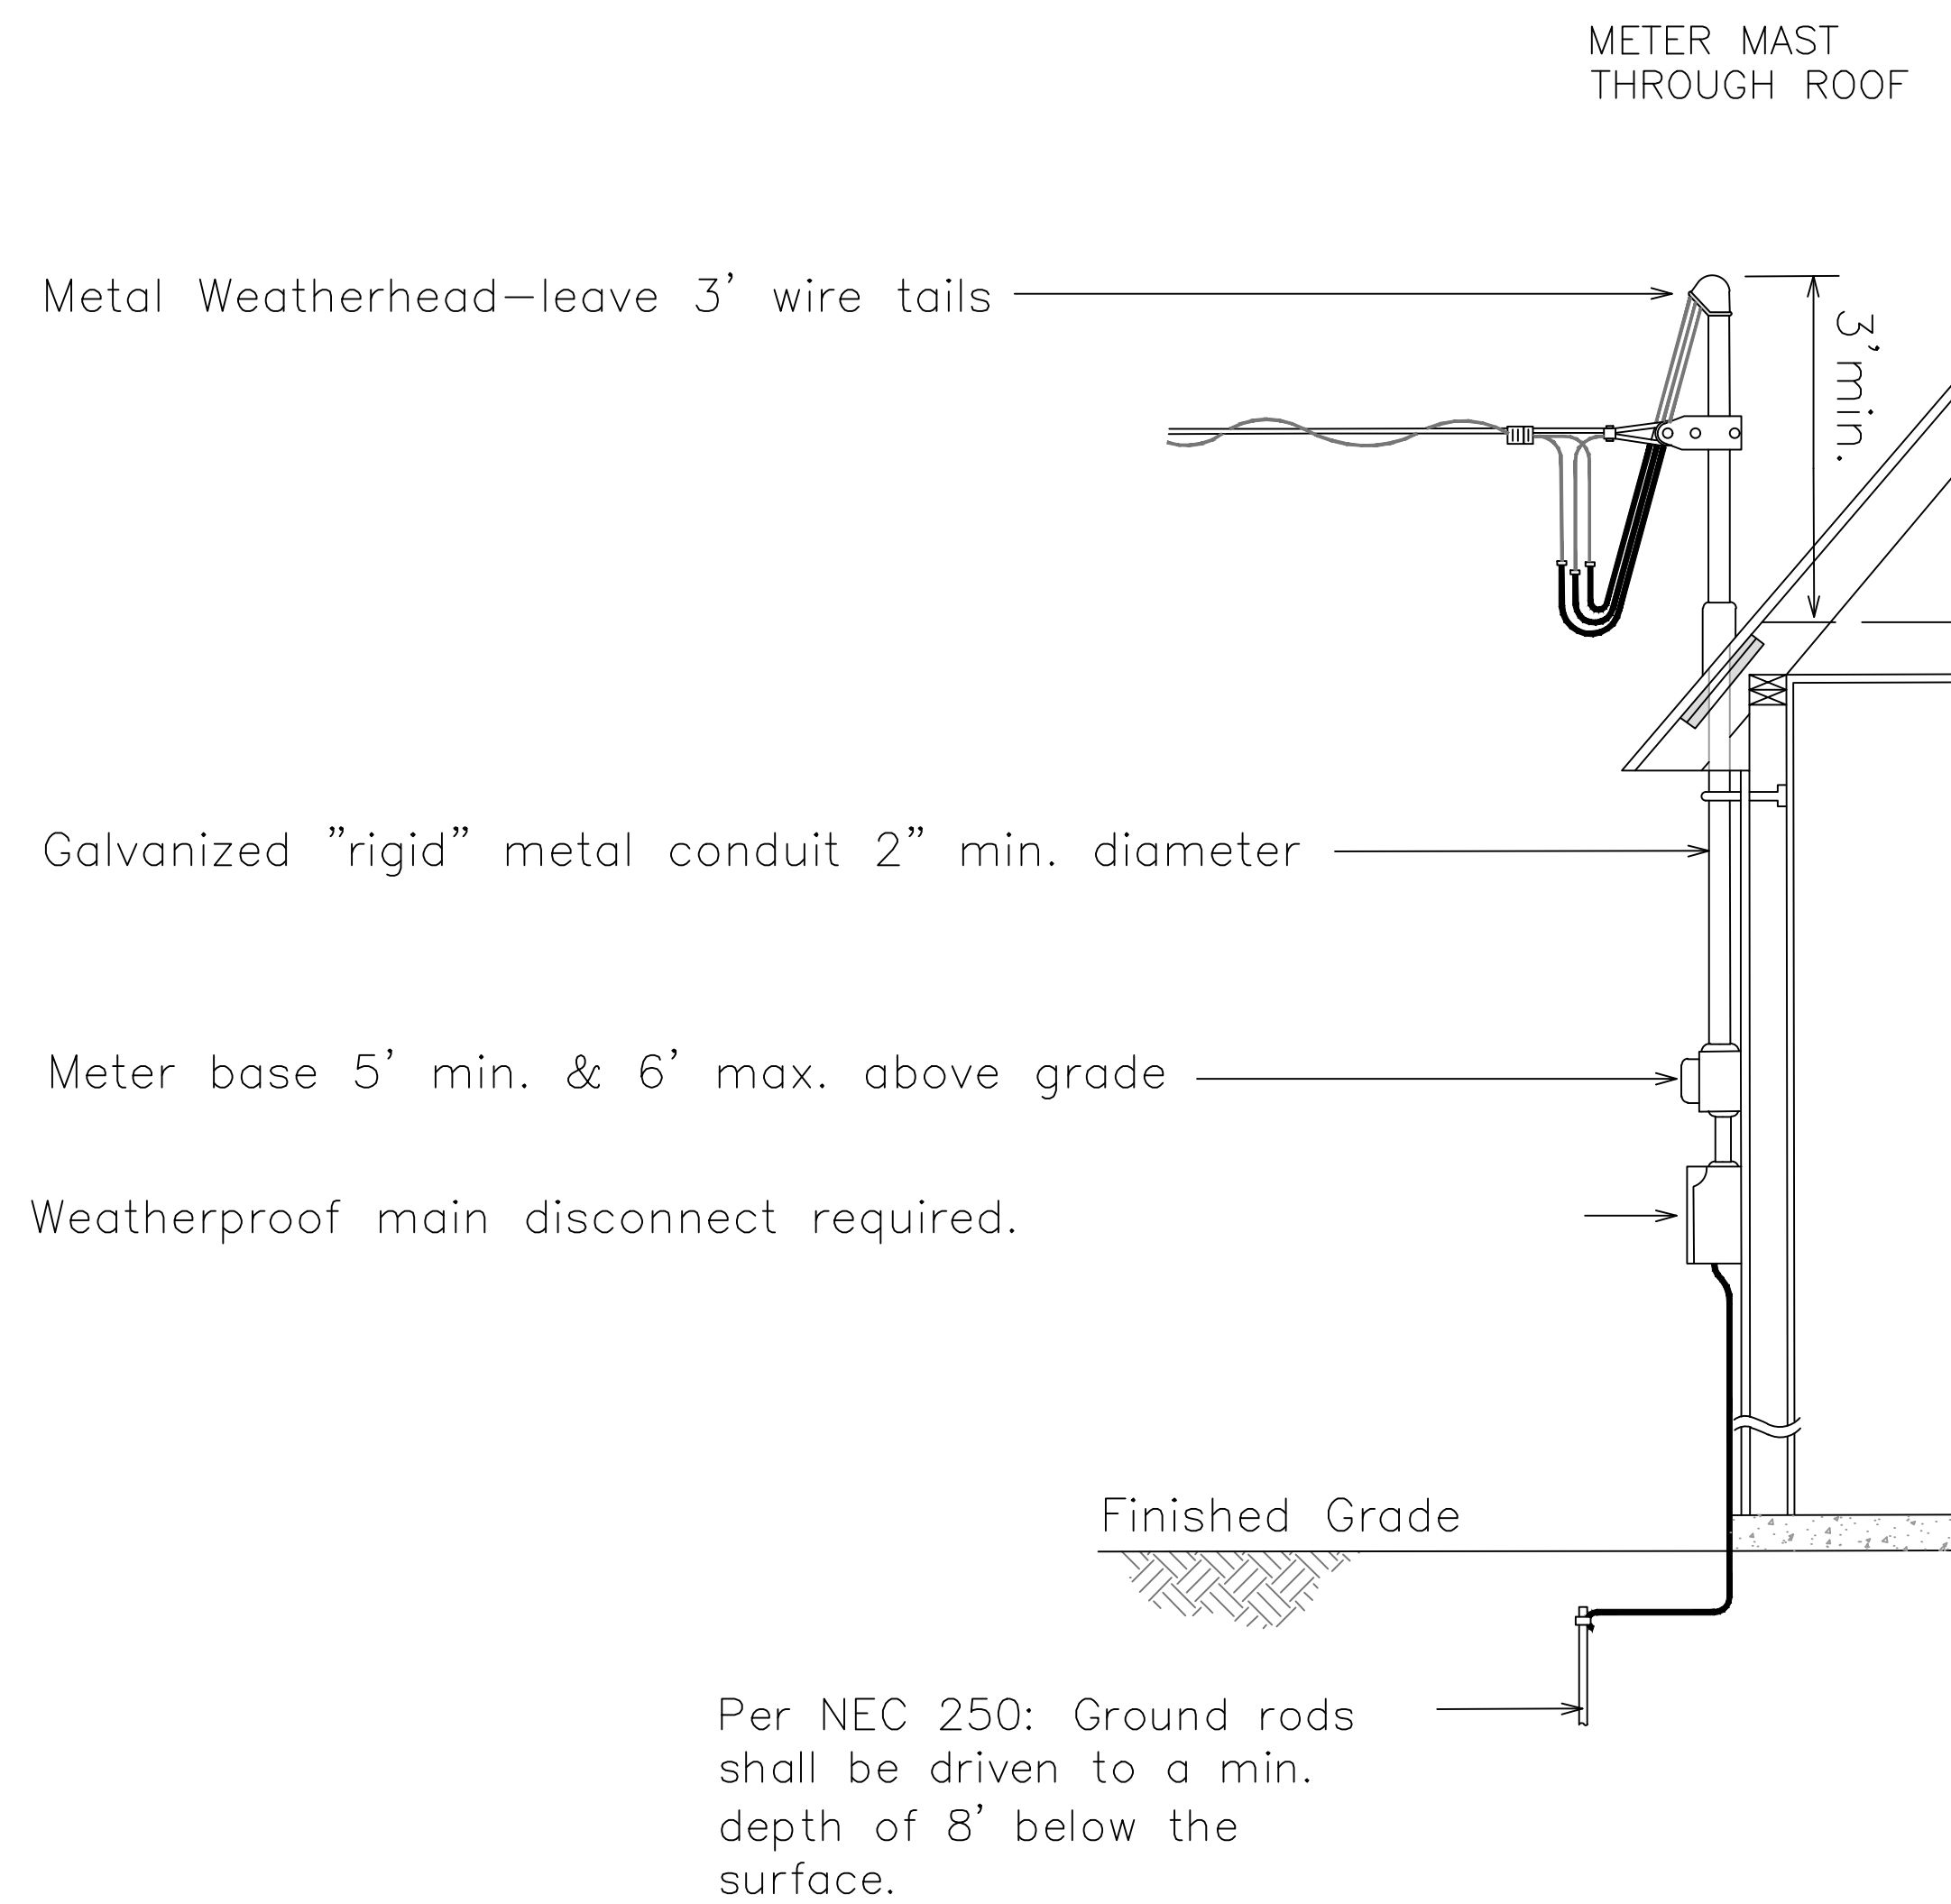

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

OH #3



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A SERVICE, THROUGH THE ROOF WITH
CLASS 200A METER SOCKET.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025