


NOTES:

1. Main disconnect panel may not be used as an electrical race way.
2. Weatherproof fittings required.
3. Notify the Bartlett Electric Cooperative when meter assembly is complete.
4. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
5. Weatherhead to be provided by electrical contractor.
6. Minimum height 12' finish grade to service wire attachment in non vehicular traffic areas.

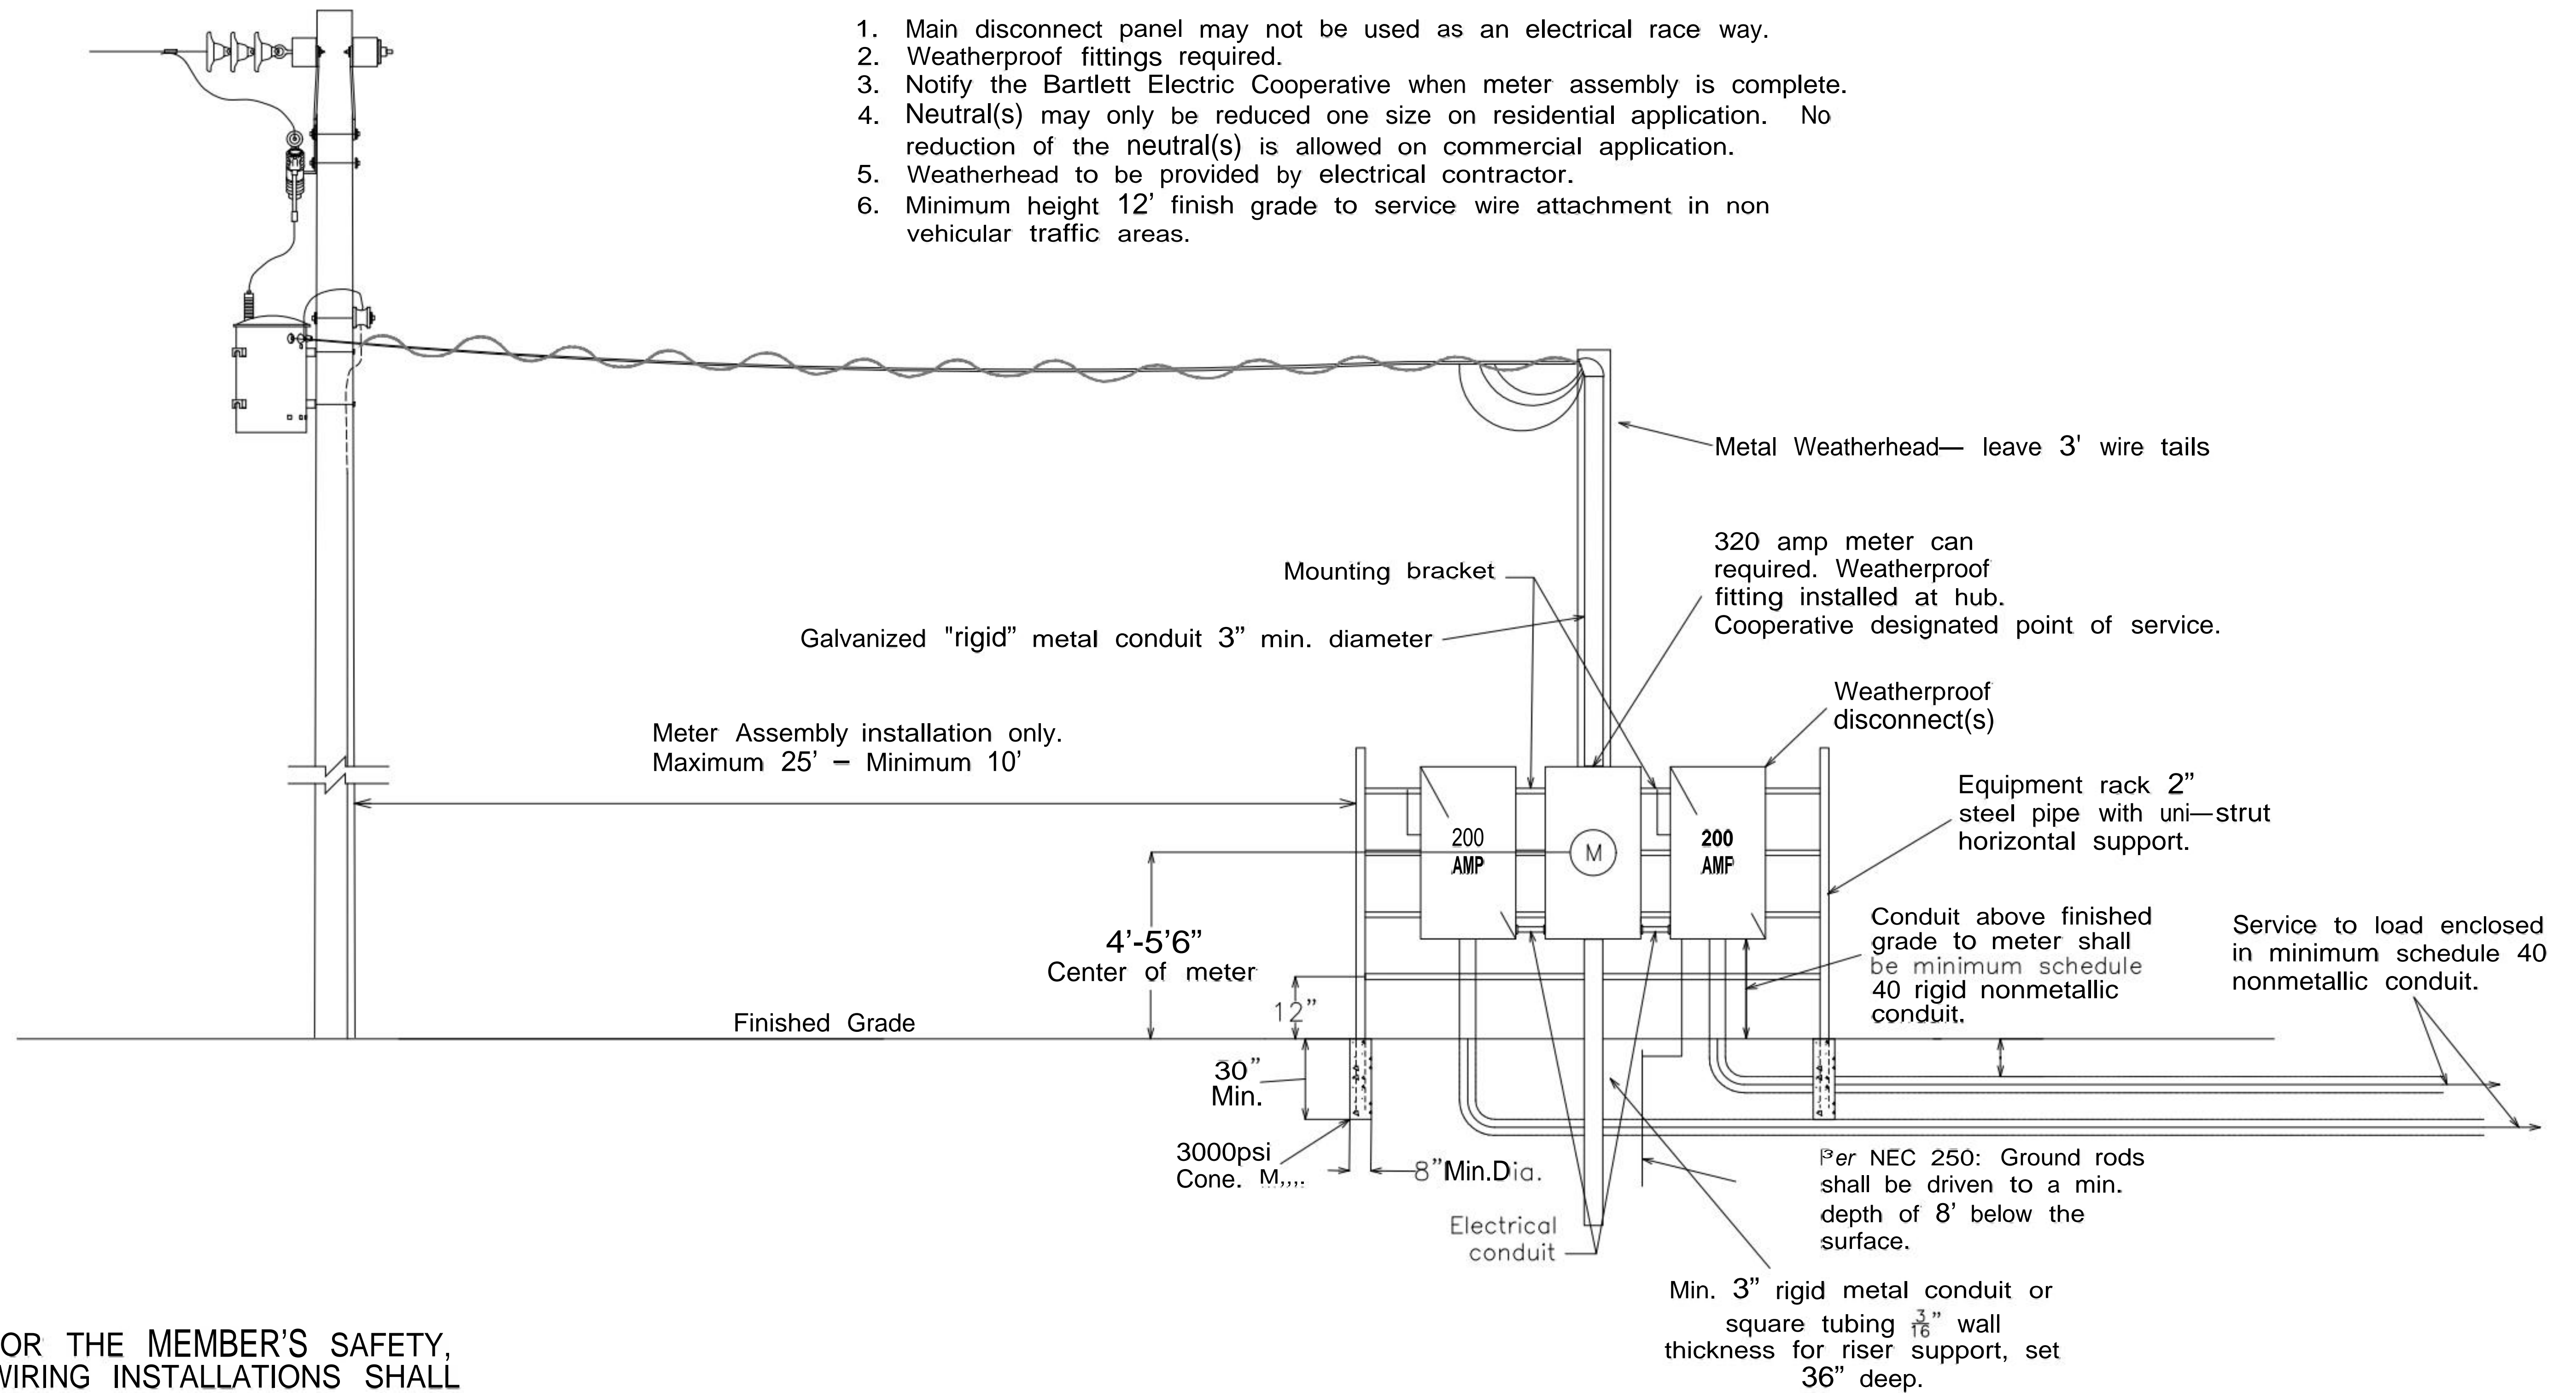

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

OH #4



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A SERVICE, TO RACK WITH
CLASS 200A METER SOCKET.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025