


NOTES:

1. All wiring must conform to National Electrical Safety Code and Municipal Code as required.
2. Municipal jurisdiction will require city inspection of loop before connection.
3. Member shall notify Bartlett Electric Cooperative when breaker is installed.
4. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.
5. If the pole is existing, member provides trenching and conduit from the pole to the UJB at the member's expense.
6. If the pole is new, BEC provides the trenching and conduit from the pole to the UJB.
7. Member provides and installs UG service wire from the UJB to the meter. Member will additionally provide trenching and conduit if the length exceeds 30'.
8. Electrical contractor will leave 5' tail at meter base so Cooperative can terminate in UJB and meter base.
9. Electrical contractor shall intercept conduit out of UJB.
10. If the UJB is 30' or less from the service point, BEC will provide conduit.

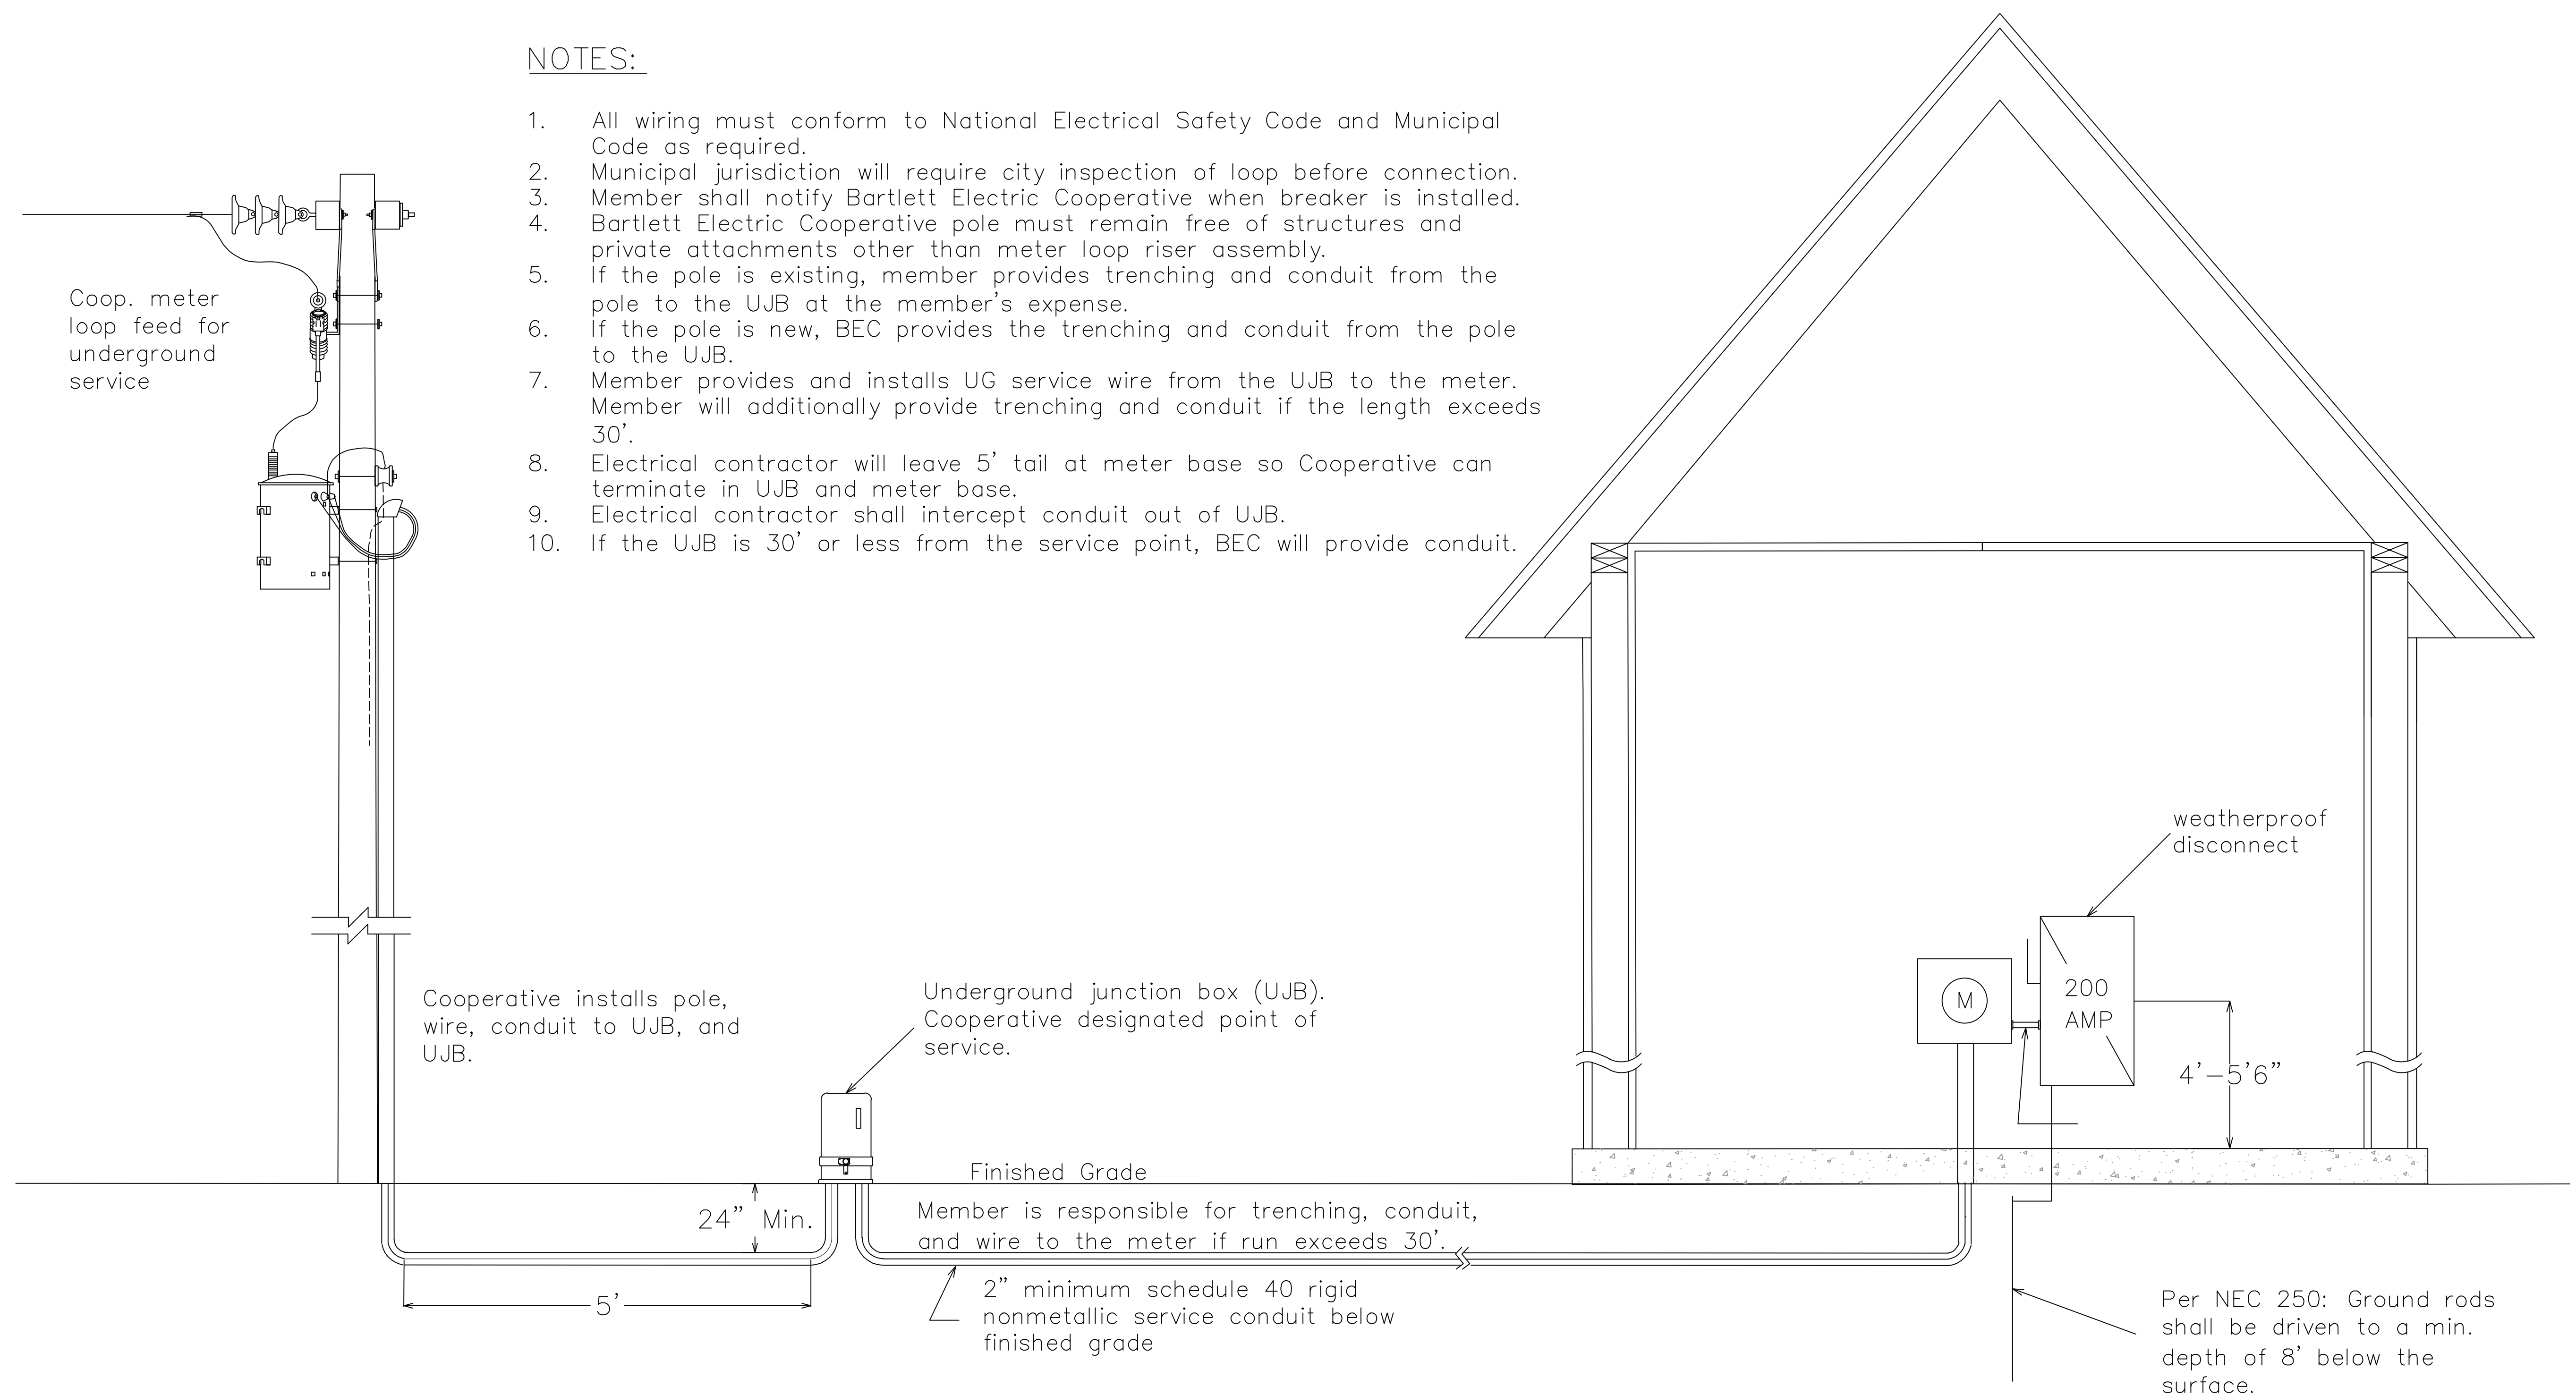

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

URD #1



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A UNDERGROUND SERVICE ON BUILDING
FROM OVERHEAD WITH 200A METER SOCKET.

| | | |
|------------------------------|----------------------------|---|
| DRAWN BY: SEP | BEC POWER APPROVAL: RSL | BEC COMM. APPROVAL: |
| APPROVAL DATE: 07-26-2021 | SCALE: NTS | REVISED BY: EMPACT ENG F-21492 03-13-2025 |