


NOTES:

1. Weatherproof fittings required.
2. Wire sized to total disconnect size.
3. Neutral may only be reduced one size on residential application. No reduction of the neutral is allowed on commercial application.
4. Member shall notify Bartlett Electric Cooperative office when meter assembly is complete.
5. Bartlett will install conduit and wire from transformer into UJB.
6. Member furnishes and installs UG service wire and conduit from UJB to meter.
7. Electrical contractor will leave 5' of tail at meter base so cooperative can terminate in UJB and meter base.
8. Electrical contractor will intercept conduit stub out from UJB.

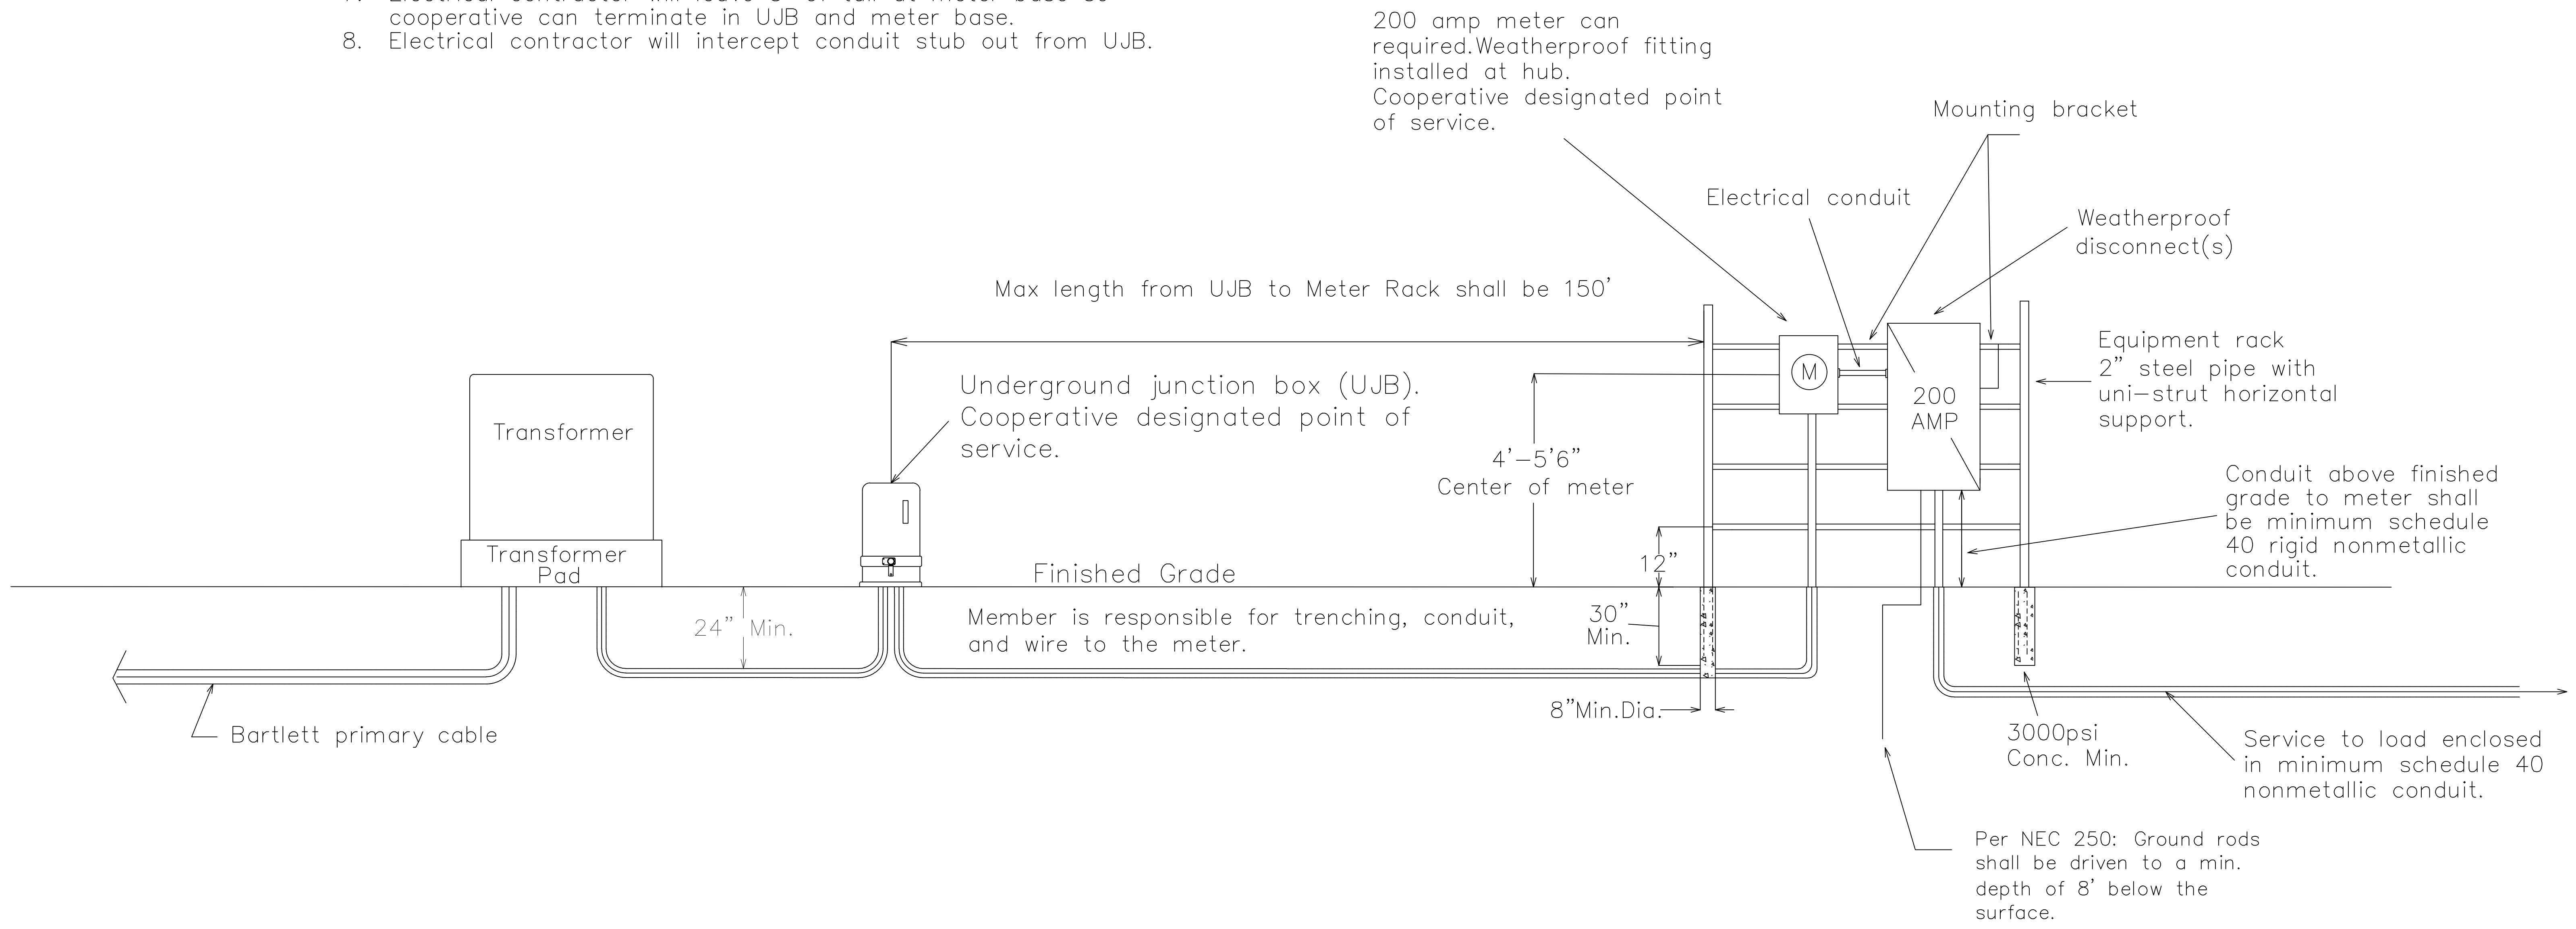

FOR THE MEMBER'S SAFETY,  
WIRING INSTALLATIONS SHALL  
CONFORM TO THE REQUIREMENTS  
OF THE NEC AND NESC.

RESIDENTIAL

URD #10



27492 HWY 95  
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A URD SERVICE ON RACK WITH CLASS 200A  
METER SOCKET – UJB OPTION

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-18-2025