


NOTES:

1. All wiring must conform to National Electric Code, National Electrical Safety Code, and Municipal Code as required.
2. Municipal jurisdiction will require city inspection of loop before connection.
3. Member shall notify Bartlett Electric Cooperative when breaker is installed.
4. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.

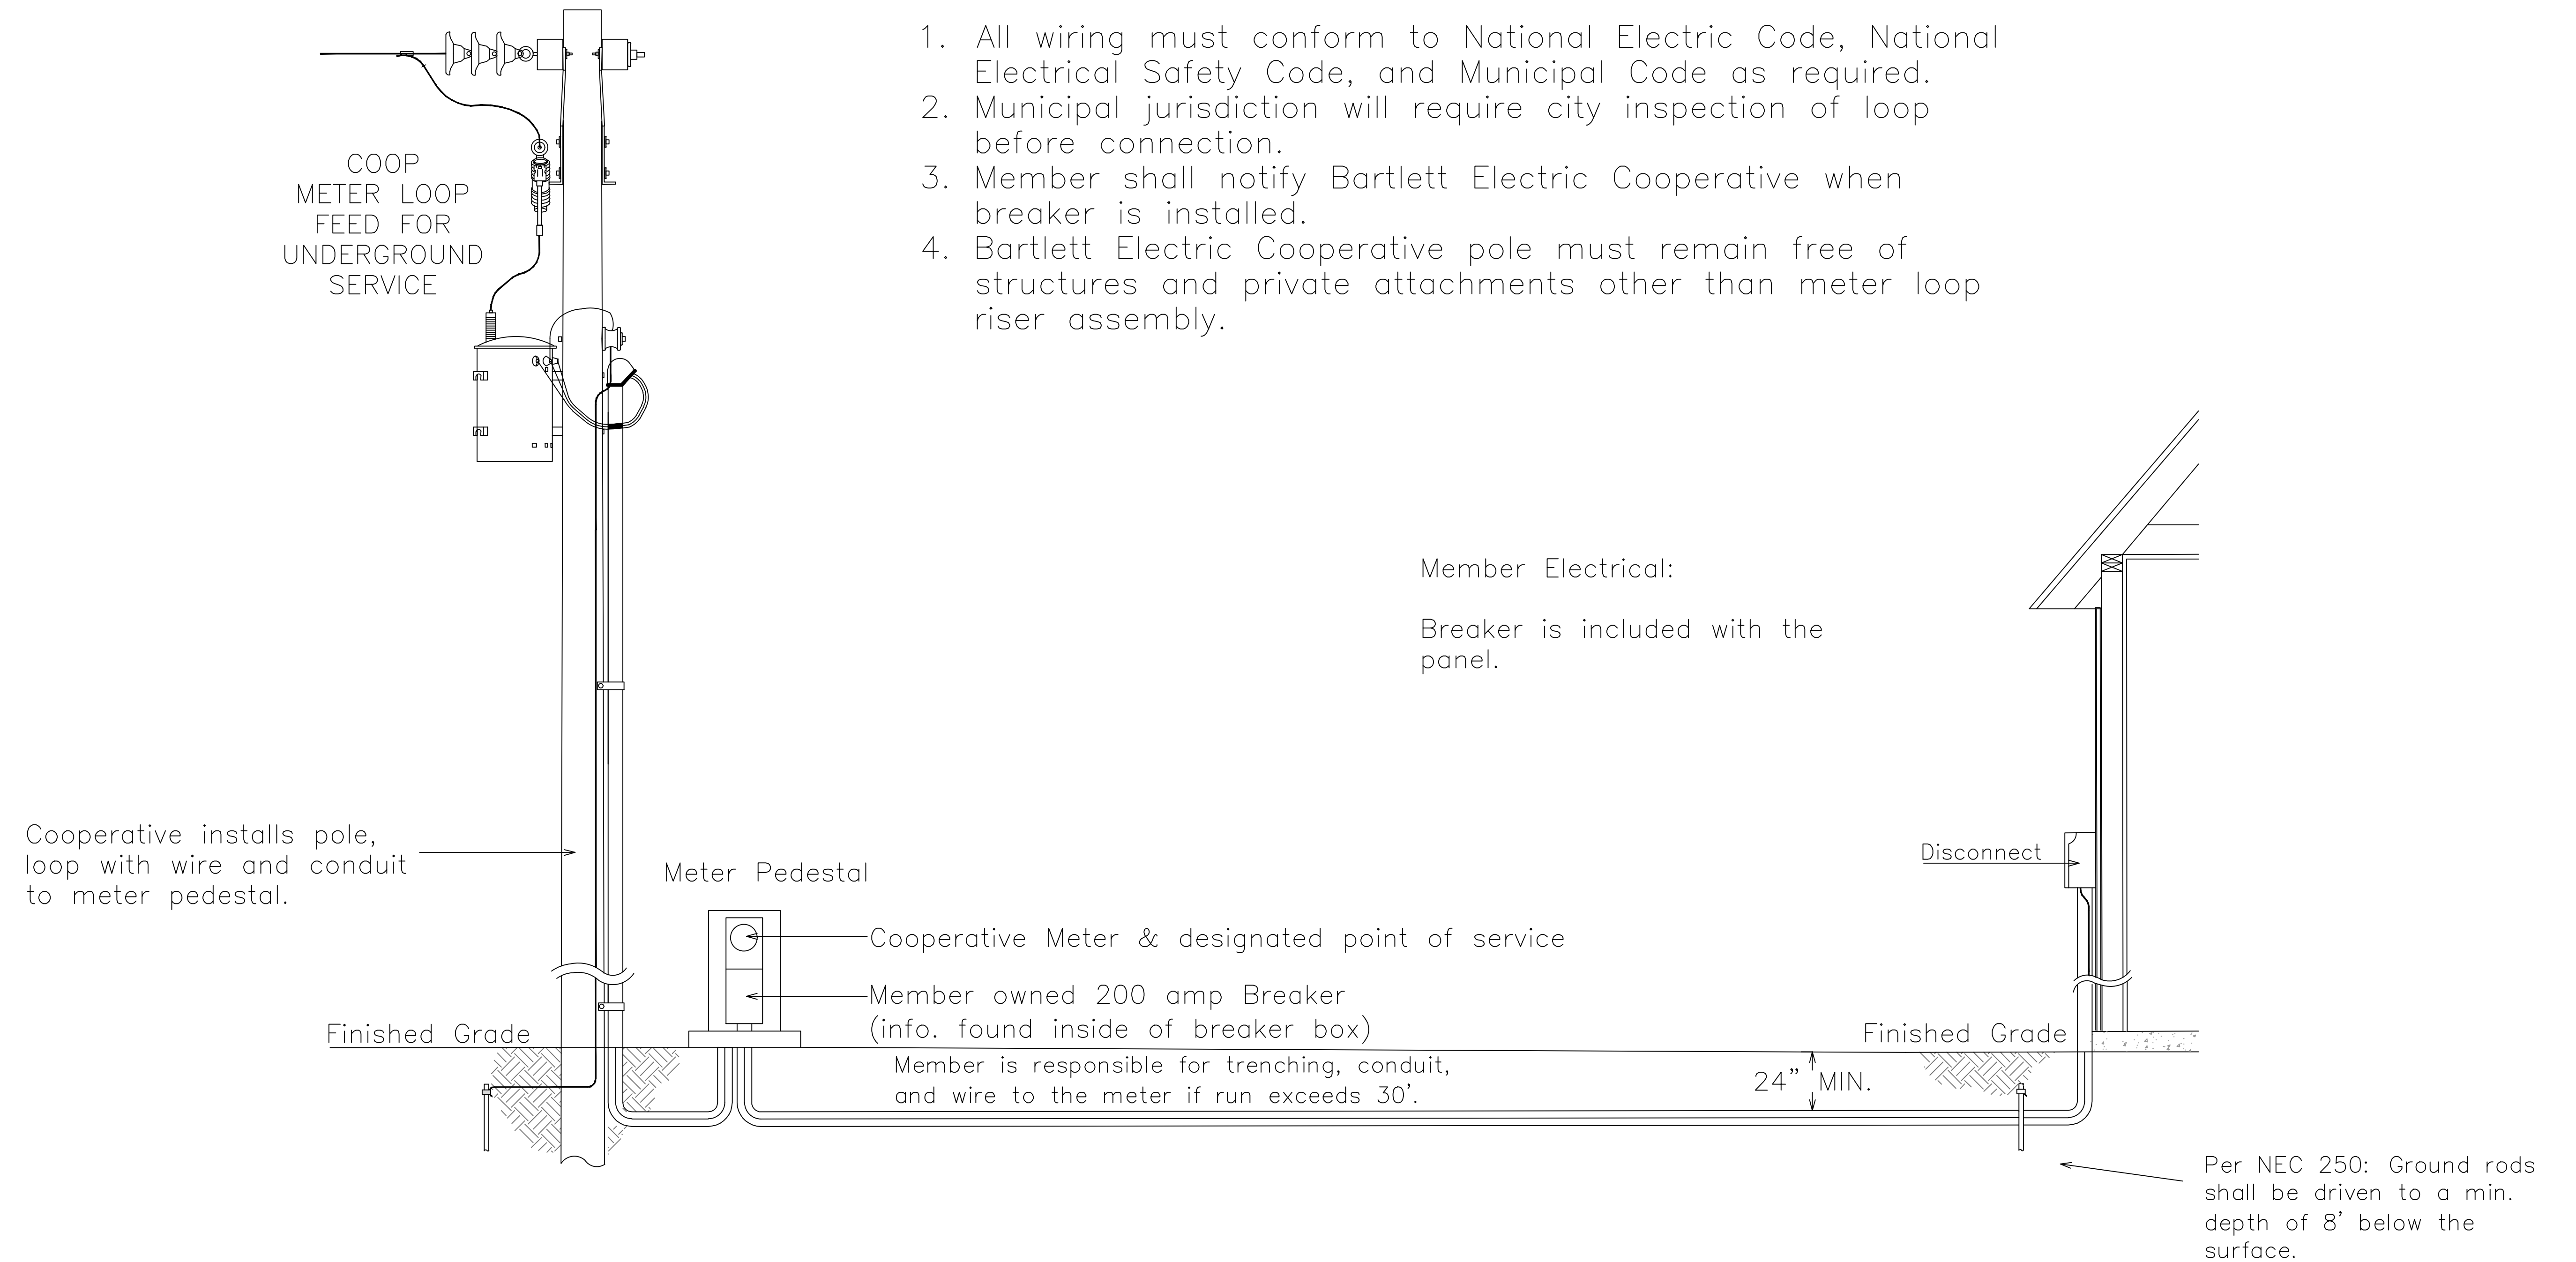

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

URD #3



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A UNDERGROUND SERVICE CLASS 200A
METER AND PEDESTAL.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE: 07-26-2021	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025