


NOTES:

1. Weatherproof fittings required.
2. Member shall notify Bartlett Electric Cooperative when meter assembly is complete.
3. Neutral may only be reduced one size on residential application. No reduction of the neutral is allowed on commercial application.
4. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.
5. If pole is existing, member provides trench and conduit from rack to pole (2" SCH. 40 PVC conduit, 18" 90° minimum sweeps).
6. If pole is new, member will provide trenching and BEC will install conduit.
7. BEC will install wire from pole to meter assembly.

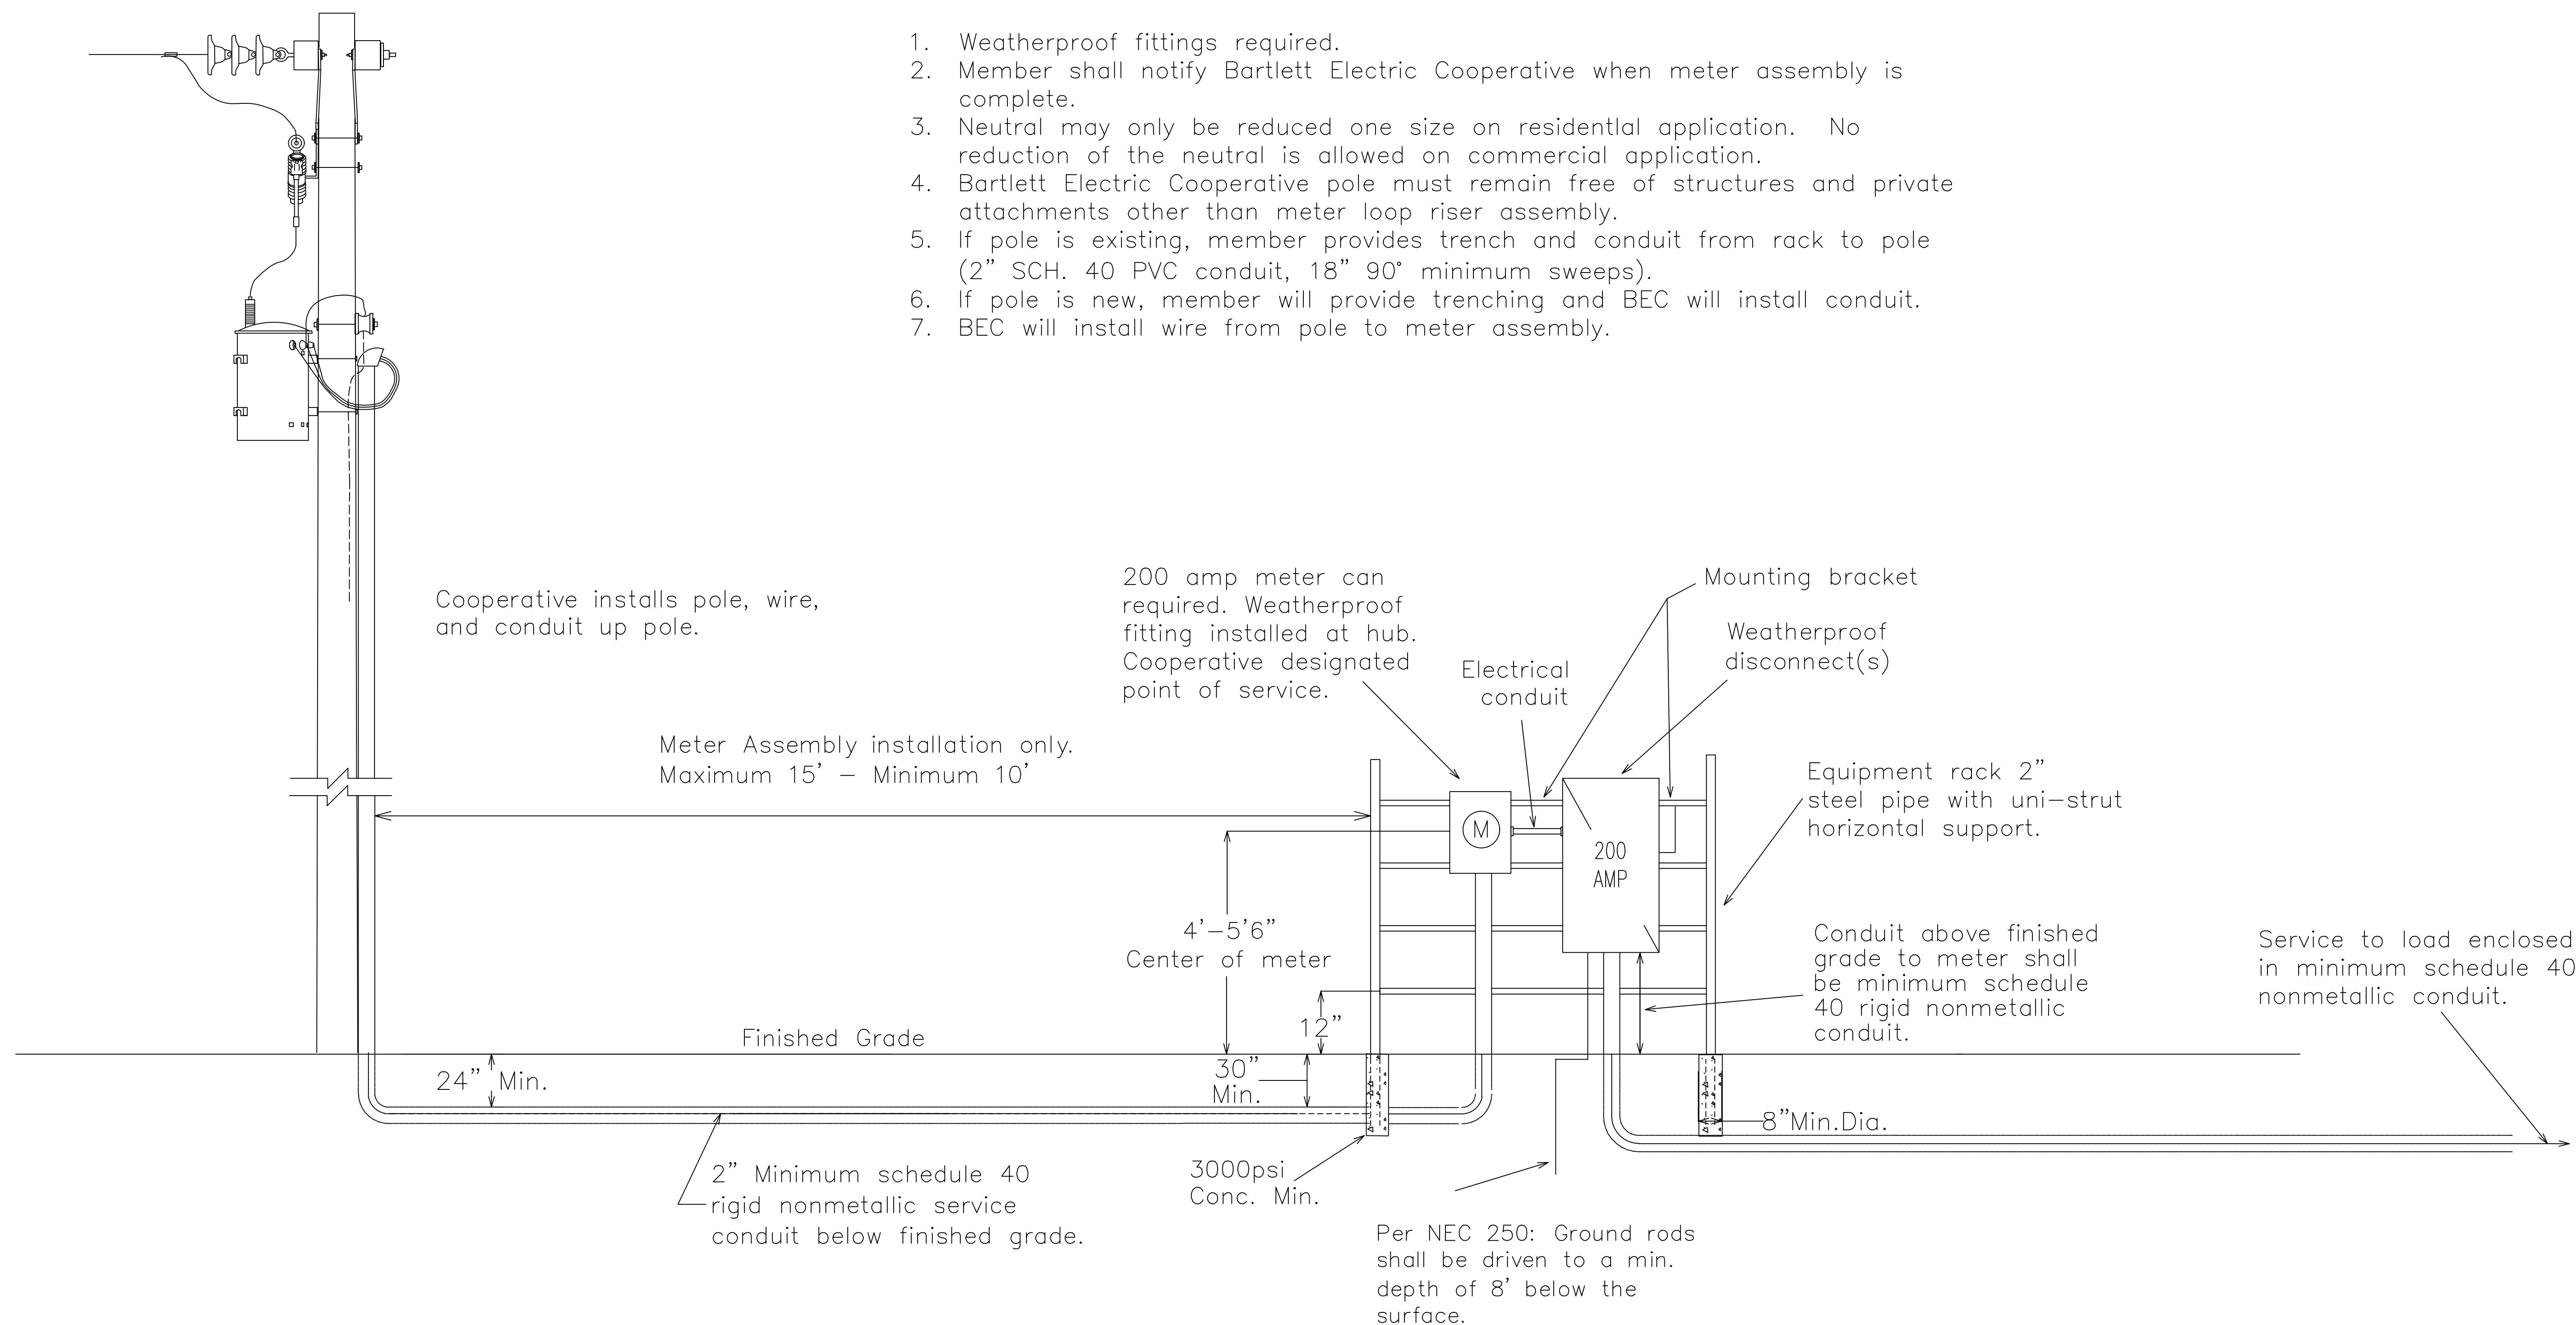

FOR THE MEMBER'S SAFETY,  
WIRING INSTALLATIONS SHALL  
CONFORM TO THE REQUIREMENTS  
OF THE NEC AND NESC.

RESIDENTIAL

URD #4



27492 HWY 95  
BARTLETT, TEXAS 76511

SINGLE PHASE, 200A URD SERVICE ON RACK FROM OVERHEAD  
WITH CLASS 200A METER SOCKET.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025