


NOTES:

1. Main disconnect panel may not be used as an electrical race way.
2. Weatherproof fittings required.
3. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
4. Member shall notify Bartlett Electric Cooperative office when meter assembly is complete.
5. Bartlett will install conduit and wire from transformer into UJB.
6. Member provides and installs UG service wire from the UJB to the meter. Member will additionally provide trenching and conduit if the length exceeds 30'.
7. Electrical contractor will leave 5' of tail at meter base so cooperative can terminate in UJB and meter base.
8. Electrical contractor will intercept conduit stub out from UJB.

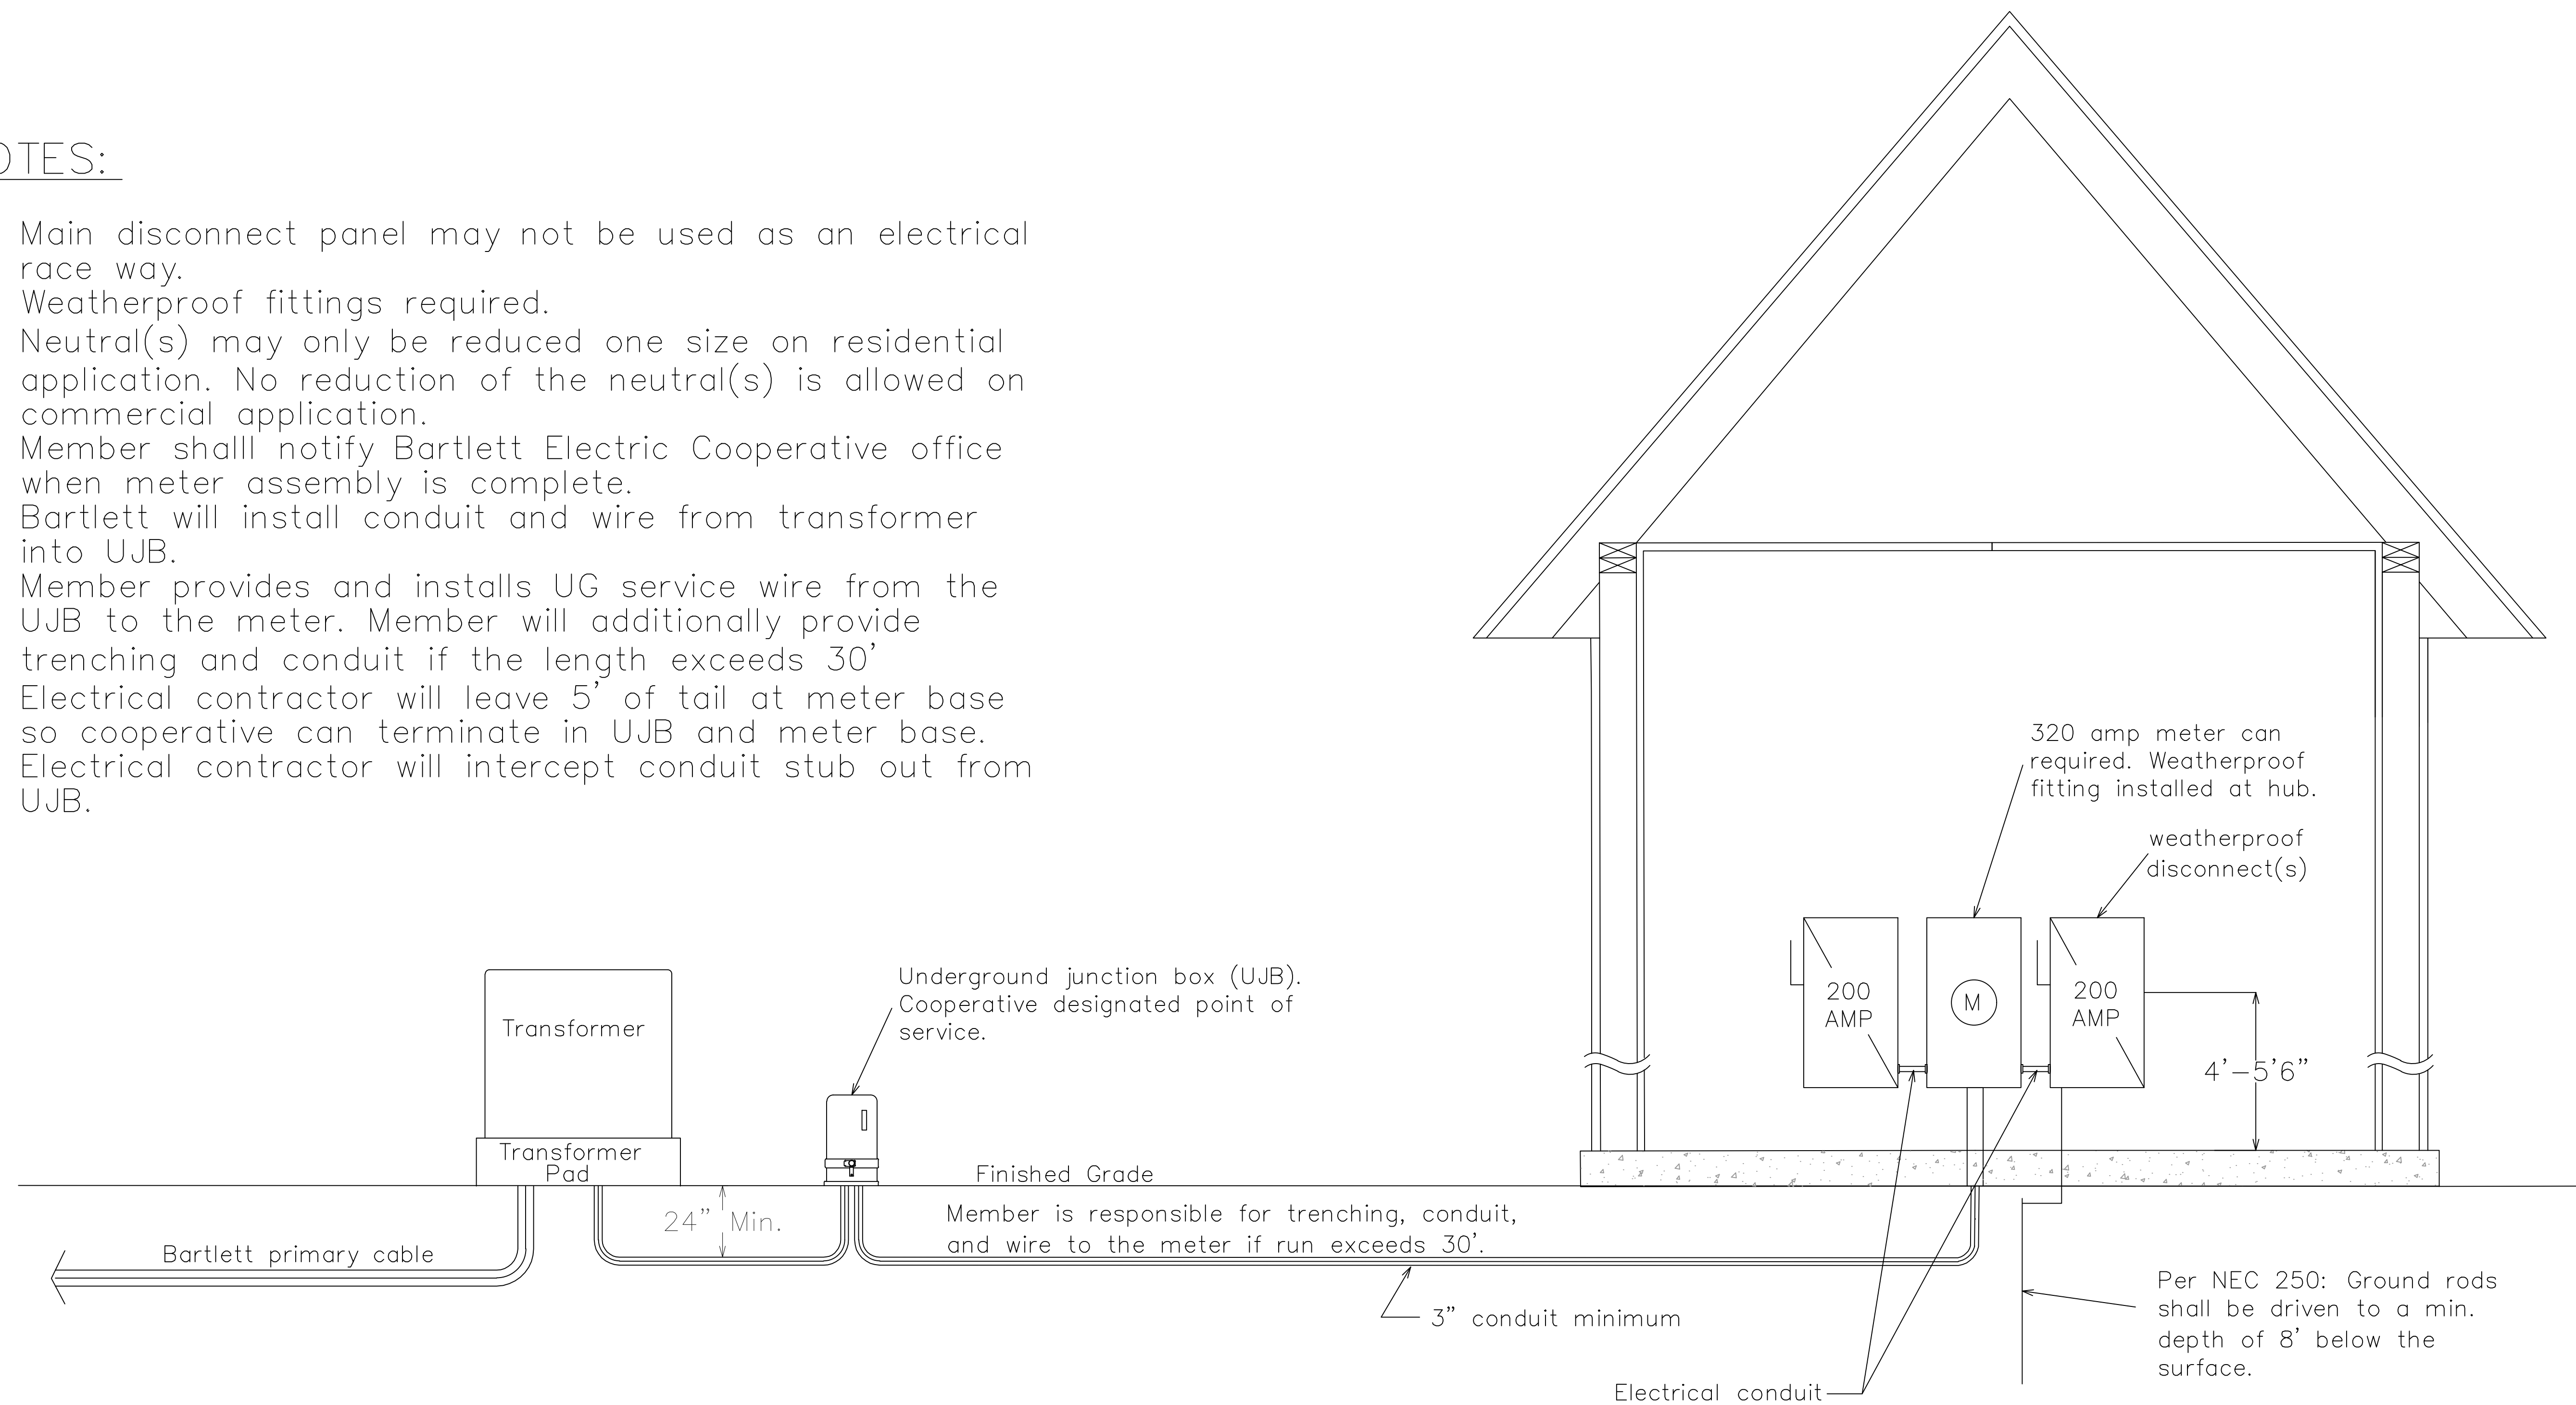

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

URD #7



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 320A SERVICE ON BUILDING WITH CLASS 320A
METER SOCKET.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025