


NOTES:

1. Main disconnect panel may not be used as an electrical race way.
2. Weatherproof fittings required.
3. Member shall notify the Bartlett Electric Cooperative when meter assembly is complete.
4. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
5. Bartlett Electric Cooperative pole must remain free of structures and private attachments other than meter loop riser assembly.
6. If pole is existing, member provides trench and conduit from rack to pole (3" SCH. 40 PVC conduit, 24" 90° minimum sweeps).
7. If pole is new, member will provide trenching and BEC will install conduit.
8. Bartlett will install wire from pole to meter assembly.

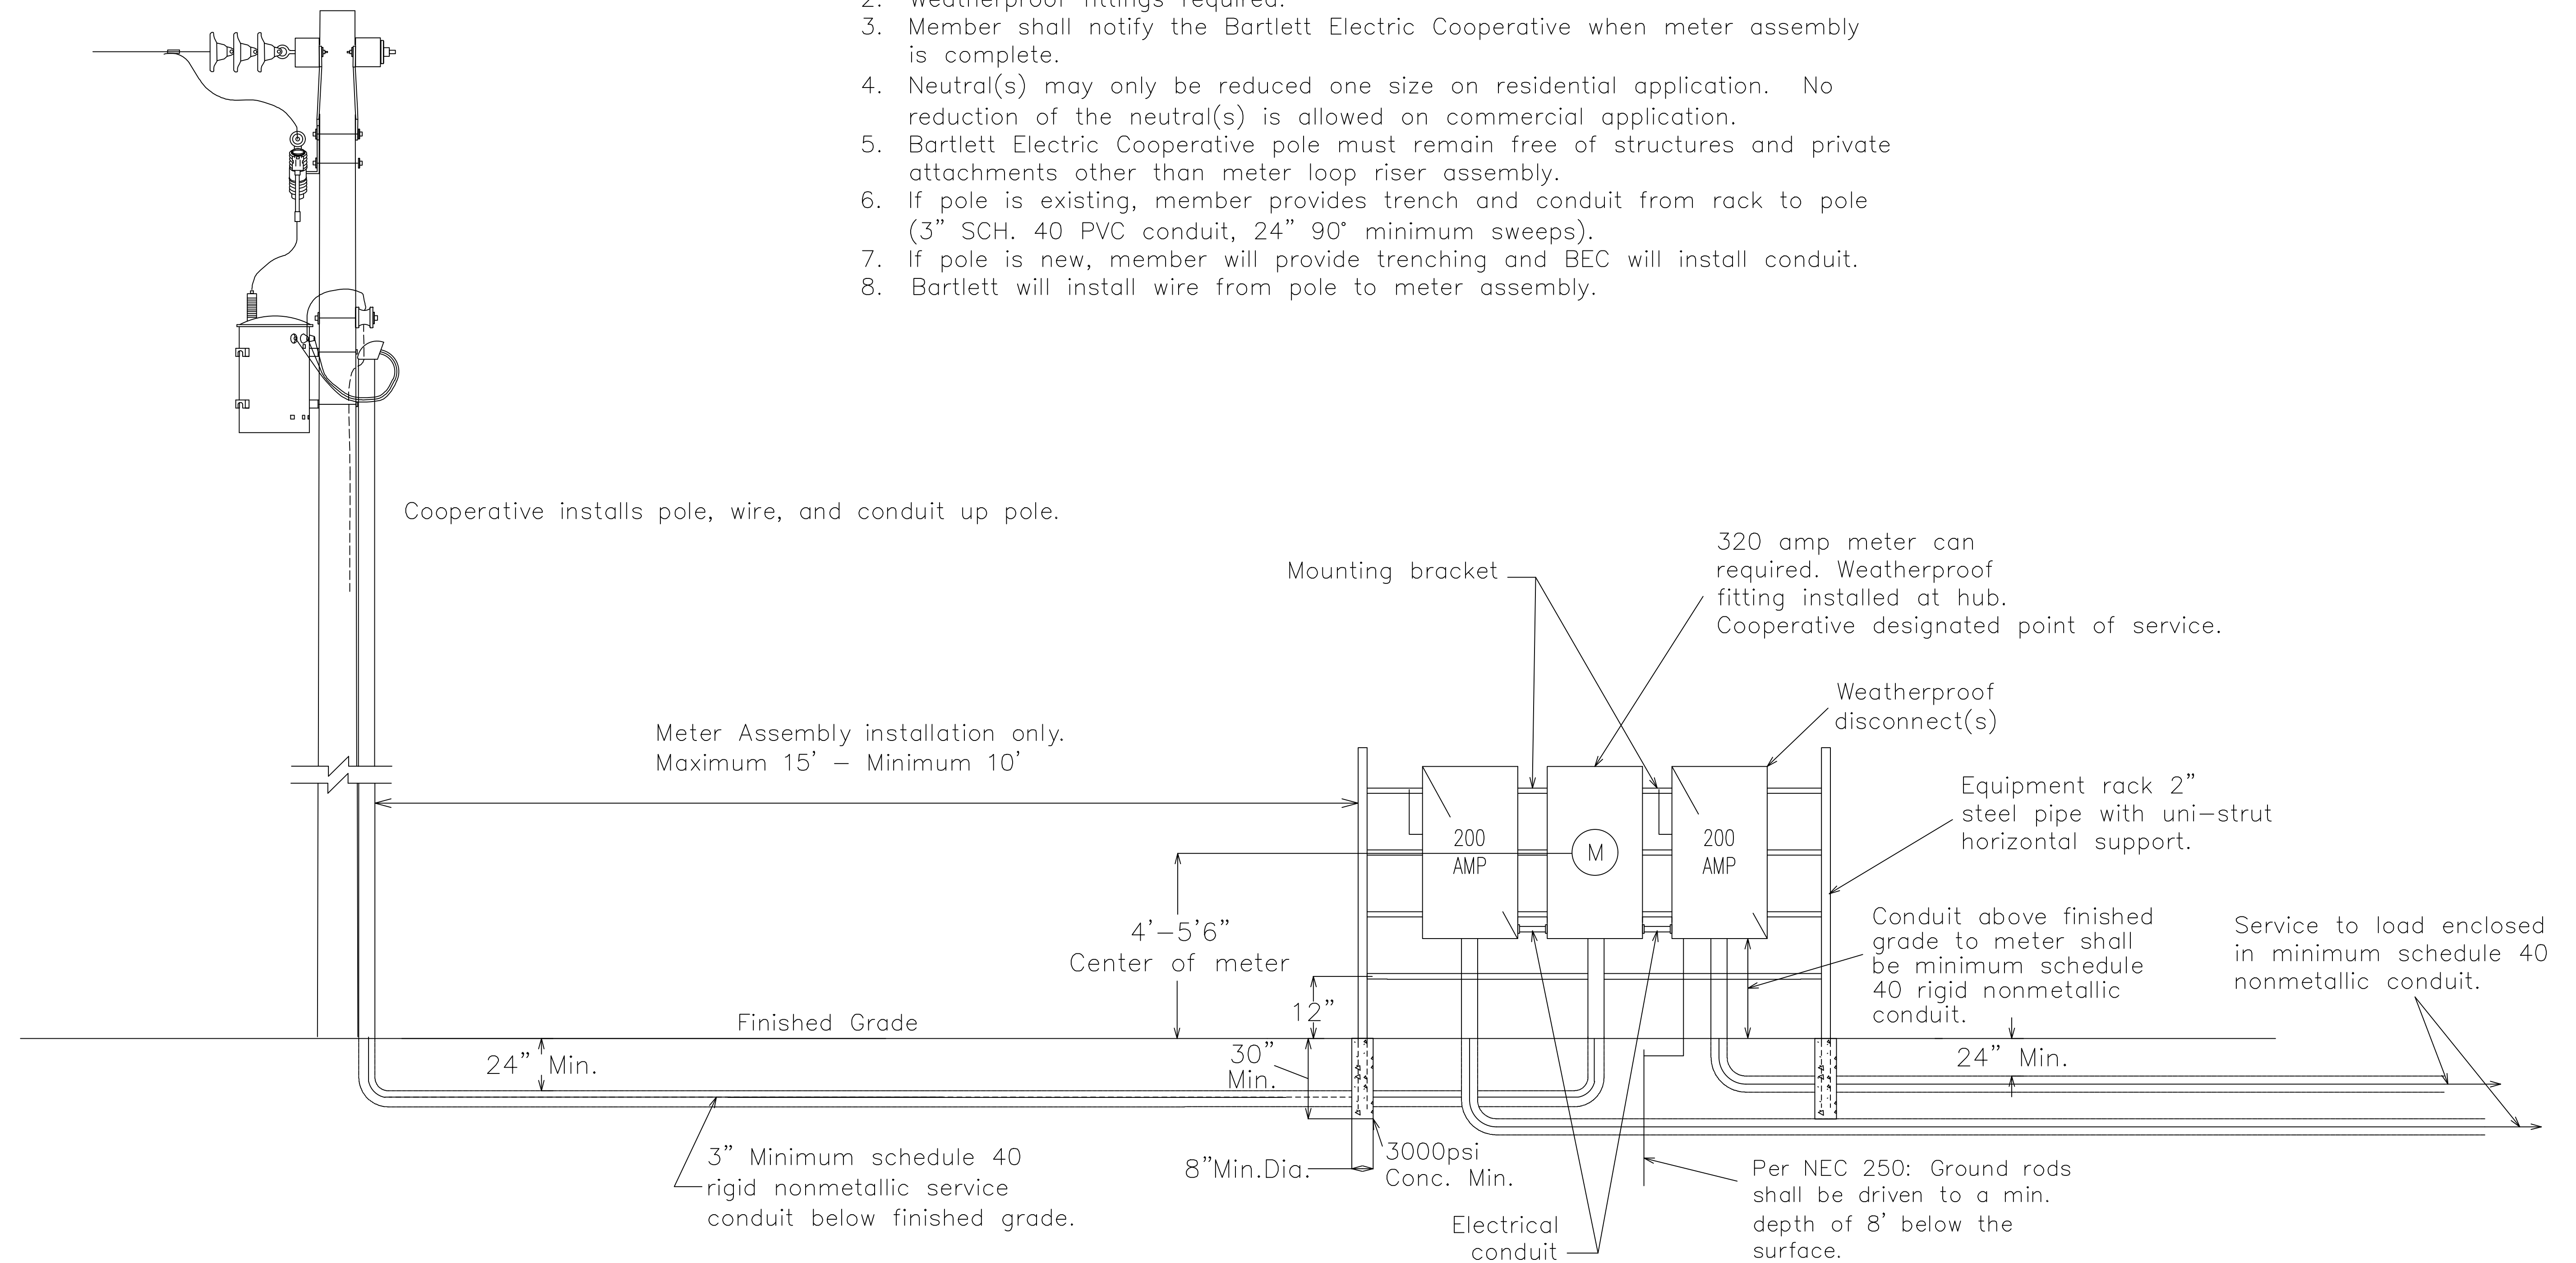

FOR THE MEMBER'S SAFETY,
WIRING INSTALLATIONS SHALL
CONFORM TO THE REQUIREMENTS
OF THE NEC AND NESC.

RESIDENTIAL

URD #8



27492 HWY 95
BARTLETT, TEXAS 76511

SINGLE PHASE, 320A URD SERVICE ON RACK FROM OVERHEAD
WITH CLASS 320A METER SOCKET, 1 OR 2 DISCONNECTS.

DRAWN BY: SEP	BEC POWER APPROVAL: RSL	BEC COMM. APPROVAL:
APPROVAL DATE:	SCALE: NTS	REVISED BY: EMPACT ENG F-21492 03-13-2025